


### INSTALLATION INSTRUCTIONS

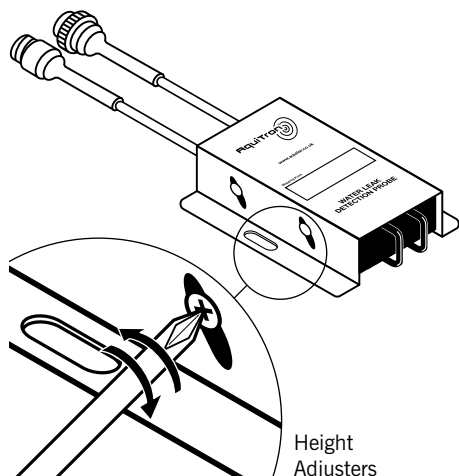

#### General Information

Please read these instructions carefully and keep them in a safe place for future reference. These instructions must be followed carefully to ensure proper operation.

The modular water detection probe has been specifically designed for use with TraceTek and AquiTron™ leak detection systems.

The modular Probe is designed for use in ordinary areas with temperatures of 0°C to 50°C (32°F to 122°F).

**NOTE:** Adjust sensor tip height to suit the application and surrounding environment.

#### Tools required


Phillips (cross-head) screwdriver  
Small flat-head screwdriver

#### Zones / Regions

Probes with terminal strips and built in resistors [weighted lengths] equal to 8 mtrs (25 feet) for the first probe and 16 mtrs (50 feet) for each subsequent probe when used on the TraceTek TTDM-PLUS or TTSIM-1/1A alarm & locator panel. If probes are used alone on a circuit without sensing cable the "zones" setting can be used on the panels.


#### Single probe

Connect to TraceTek / AquiTron™ Leak detection Panel via a leader cable (TT-MLC-PC) or combination of modular leader cable and modular jumper cable

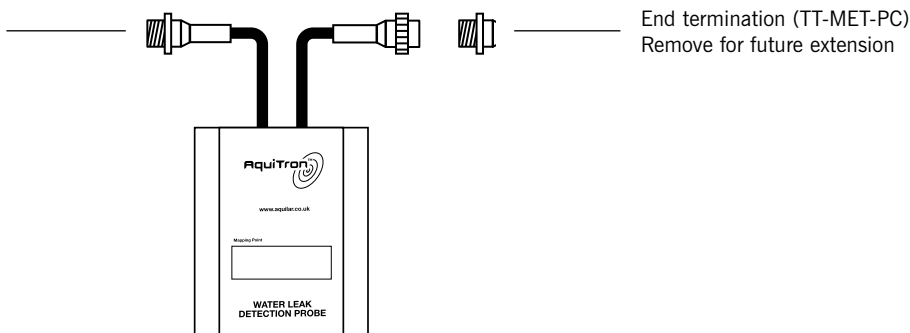

#### Multiple probes

Connect to TraceTek / AquiTron™ Leak detection Panel via a leader cable (TT-MLC-PC) or combination of modular leader cable and modular jumper cable

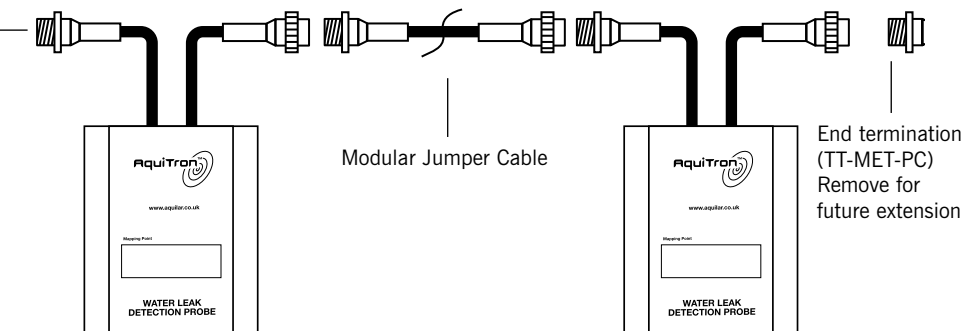

**Important:** All information, including illustrations, is believed to be reliable. Users, however, should independently evaluate the suitability of each product for their application. Aquilar Limited makes no warranty as to the accuracy or completeness of the information, and disclaims any liability regarding its use. The only obligations of Aquilar Limited are those in the Aquilar Standard Terms and Conditions of Sale for this product, and in no case will Aquilar Limited be liable for any incidental, indirect, or consequential damages arising from the sale, resale, use or misuse of the product. Specifications are subject to change without notice. In addition, Aquilar Limited reserves the right to make changes - without notification to Buyer - to processing or materials that do not affect compliance with any applicable specification.

AquiTron is a trademark of AquiTron Limited  
Aquilar is a trademark of Aquilar Limited  
TraceTek is a trademark of Tyco Thermal Controls

#### Aquilar Limited

Weights & Measures House, 20 Barttelot Road,  
Horsham, West Sussex RH12 1DQ. UK  
Tel: + 44 (0) 1403 216 100  
Fax: +44 (0) 8707 940 320

E-mail: [info@aquilar.co.uk](mailto:info@aquilar.co.uk)  
[www.aquilar.co.uk](http://www.aquilar.co.uk)

Master TraceTek Distributor UK & Ireland for  
**Raychem® TraceTek®**  
Water, Fuel and Chemical Leak Detection