




Leak Detection and Locating Systems

The danger of environmental contamination and the potential repair costs of an undetected fuel leak along a pipeline can be astronomical.

TraceTek Leak Detection and Locating Systems can monitor miles of single wall buried pipelines for fuel leaks, provide a precise location of a small developing leak, close valves before it becomes catastrophic, and interface with a pipeline monitoring control center for notification.



TraceTek Leak Detection System being installed in a 12 km "High Consequence Area" along the Longhorn Pipeline in Austin, TX

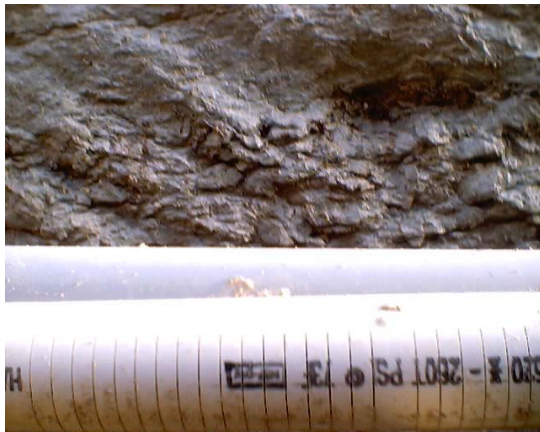

Schedule 80 PVC slotted conduit



TraceTek TT5000 Sensing Cable installed inside slotted PVC conduit along side a single wall buried pipeline

TraceTek TT5000 Sensing Cable installed inside slotted PVC conduit along side a single wall buried pipeline can detect a small fuel leak and identify the location with pinpoint accuracy. Traces of any fuel leakage are drawn into the conduit by capillary action and contact the sensing cable for detection and location of the leak.


Application Components

Catalog Number	Description
TTDM-128	Alarm and Locating Module
TTSIM-1	Sensor Interface Module
TT5000-HS	Fuel Sensing Cable
TT-JC-BLK-HS	Jumper Cable
TT-MBC-MC-BLK	Modular Branch Connector
TT-MET-MC	Modular End Termination

Single Wall Buried Pipelines



Leak Detection and Locating Systems

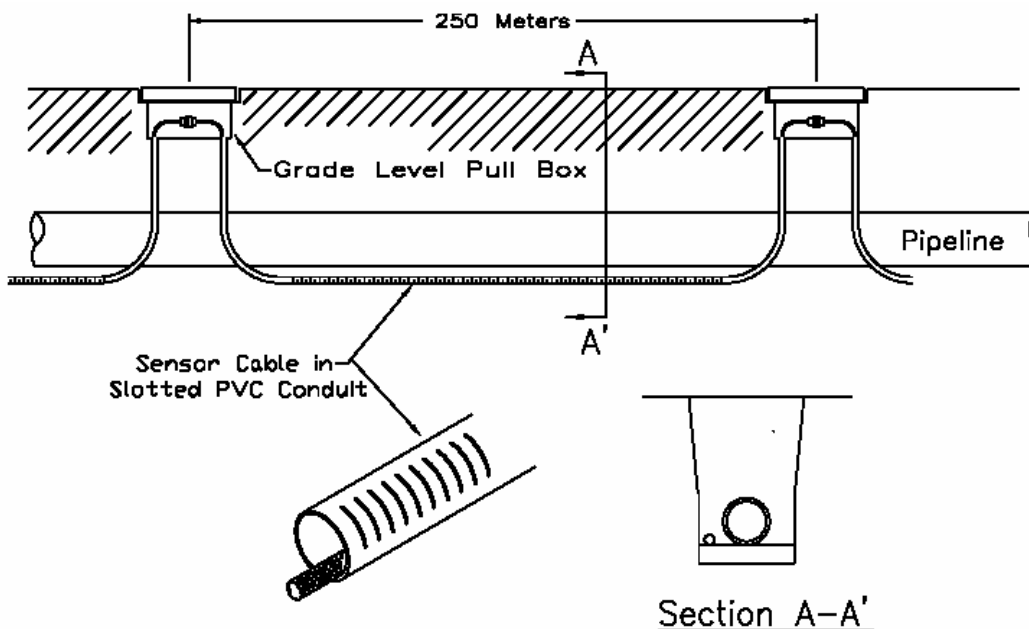

Approvals



Sensing cable may be used in Class I, Division 2, Groups A, B, C, D Hazardous Locations. If wiring from module meets requirements for intrinsic safety, sensing cable may be used in Class I, Division 1, Groups A, B, C, and D Hazardous Locations (Zone 0 or Zone 1 in Europe).



The TraceTek products group is a part of Tyco Thermal Controls. Tyco Thermal Controls is ISO 9001 Certified.

Third Party Test and Evaluation

Carnegie Mellon Research Institute "Test Procedures for Third Party Evaluation of Leak Detection Methods: Cable Sensor Liquid Contact Leak Detection Systems"

Ken Wilcox Associates, Inc "Evaluation of the TraceTek TT5000 Product Sensitive Cable For use as a Leak Detection System For Buried Pipelines"



State of Florida Department of Environmental Protection Approval of the TraceTek TT5000 Leak Detection System for Single-Walled Underground Bulk Product Piping File No. EQ-551

Tyco Thermal Controls
Worldwide Headquarters
300 Constitution Drive
Menlo Park, CA 94025-1164
USA

Tel: (800) 545-6258 (within US)
(650) 216-1526

Fax: (800) 527-5703 (within US)
(650) 474-7517

E-mail: info@tycothermal.com

www.tycothermal.com

Important: All information, including illustrations, is believed to be reliable. Users, however, should independently evaluate the suitability of each product for their particular application. Tyco Thermal Controls makes no warranty as to the accuracy or completeness of the information, and disclaims any liability regarding its use. Tyco Thermal Controls' only obligations are those in the Tyco Thermal Controls Standard Terms and Conditions of Sale for this product, and in no case will Tyco Thermal Controls or its distributors be liable for any incidental, indirect, or consequential damages arising from the sale, resale, use or misuse of the product. Specifications are subject to change without notice. In addition, Tyco Thermal Controls reserves the right to make changes – without notification to Buyer – to processing or materials that do not affect compliance with any applicable specification.

Tyco and TraceTek are trademarks or registered trademarks of Tyco Thermal Controls LLC or its affiliates.